



Industrie Service

**Mehr Sicherheit.
Mehr Wert.**

Technical Report

IS-DDB-MAN/021/08

**Fire-Safe-Test according to DIN EN ISO 10497, 11.2004
resp. API 607, fifth edition, 06.2005
at 1 gasket of the type "KLINGER®top-sil-ML1"**

Date: 19th February 2008

Our sign:
IS-DDB-MAN/jo

Document:
PB Fire-Safe_Klinger-
Austria_DIN_EN_ISO_10497-
Dichtung-top-sil-08 (E).doc

The document consists of:
5 Pages
Page 1 of 5

Applicant: Rich. Klinger Dichtungstechnik GmbH & Co.KG
Am Kanal 8-10

A – 2352 Gumpoldskirchen

Extracts of this document and the
use for advertisements need a
written authorization of TÜV Süd
Industrie Service GmbH.

The test results obtain just the
inspected test objects.

Issued on: 2008-02-19 in 2 Copies each 5 pages and 2 Attachements

Issuer: Dipl.-Ing. John



Sitz: München
Amtsgericht: München HRB 96 869

Aufsichtsratsvorsitzender:
Dr. Axel Stepken
Geschäftsführer:
Dr. Manfred Bayerlein (Sprecher)
Dr. Udo Heisel

Telefon: +49 621 395-111
Telefax: +49 621 395-594
www.tuev-sued.de
TUV®

TÜV SÜD Industrie Service GmbH
Region Baden-Württemberg
Abteilung Druckbehälter
Dudenstraße 28
68167 Mannheim
Deutschland

1. Order

Company Rich. Klinger Dichtungstechnik GmbH & Co.KG applied at TÜV SÜD Industrie Service GmbH the accomplishment of a Fire-Safe-Test according to DIN EN ISO 10497 resp. API 607, fifth edition at 1 gasket of the type „KLINGER@top-sil-ML 1“, which was flanged to a ball valve with a nominal size of DN 50, PN 40.

The test was done on the 12.02.2008 in Graben-Neudorf with presence of an authorised expert of TÜV SÜD Industrie Service GmbH.

2. Accomplishment of the test

The test assembly and the accomplishment was carried out in accordance with DIN EN ISO 10497 (see installation scheme).

3. Test result

The test results mentioned in the attachment show that the requirements according DIN EN ISO 10497 resp. API 607, fifth edition have been achieved by the gasket

KLINGER@top-sil-ML1, DN 50, nominal pressure PN 40 thickness 1,5 mm, see data sheet in the attachment

in combination with a ball valve INTEC K200-FS.

The gasket was tightened with a torque of 150 Nm which is equal to a surface pressure of 38 N/mm².

4. Area of application

According to the testing of a gasket DN 50 simultaneously the requirements for gaskets of the same type are valid for nominal size DN 50 and below, DN 65, DN 80 and DN 100.

According to the testing of the gasket for a nominal pressure PN 40, gaskets of the same type for nominal pressures PN 40, PN 63 and PN 100 are also covered.

Test protocol

1. **Date of the test** February 12., 2008
2. **Location of the test** KLINGER SCHÖNEBERG GmbH
Heidelberger Straße 3
76676 Graben-Neudorf
3. **Test specifications** DIN EN ISO 10497, 11.2004 resp. API 607, fifth edition, 6.2005
4. **Gasket manufacturer** Rich. Klinger Dichtungstechnik GmbH & Co. KG
Am Kanal 8-10
A – 2352 Gumpoldskirchen
5. **Tested gasket (in combination with 1 ball valve)**

Gasket KLINGER@top-sil-ML1; DN50, PN40
Thickness 1,5 mm; Torque 150 Nm;
Surface pressure 38 N/mm²
See data sheet as attachment
6. **Test ball valve** INTEC K200-FS, DN50, PN40
Material valve body/flange: 1.4408
7. **Test conditions**

Test fluid: Water

Test fuel: Liquid gas acc. DIN 51622

Burn period: 30 minutes

Thermocouples: The temperature of the flames after 2 minutes should be 750 °C; the average temperature at the flame area should be between 750 °C and 1000 °C and should not fall below 700 °C.

Calorimeter cubes: The average temperature after 15 minutes should be 650 °C. This temperature should be held during the burn period and should not fall below 560 °C.

Test pressure:
(Low-pressure) 2 bar
(High-pressure) 30 bar



8. Test procedure

8.1 Preliminary test: Tightness test of the valve with water (1,4 x PN)

Test pressure: 56 bar

Result: Ball valve was tight

8.2 Burn period

Temperatures of the Calorimetercubes

Temperature after 15 min		Average temperature after 15 min till end of the burn period	
		K1	K2
Ball valve	Temperature 736 °C	750 °C	767 °C

Temperatures of the thermocouples

Temperature after 2 min		Average temperature	
		T1	T2
Ball valve	Temperature 1040 °C	927 °C	940 °C

8.3 Cooling-down period of the ball valve to 100°C

Ball valve 9 Min

8.4 Through-seat leakage during burn period

max. permissible Leakage during the burn period: 200 ml/min

determined leakage: Ball valve 364 ml

Result: passed

8.5 Closing of the fuel supply and cooling down to 100 °C

Cooling down with air blast cooling and water.

8.6 External leakage during the burn period and the cooling-down period

max. permissible leakage during the burn period and cooling down period: 50 ml/min

determined leakage: Ball valve 0 ml



Industrie Service

Result: passed

8.7 For valves PN 100 and below the test pressure should be held constant at 2 bar and the leakage through the seat should be measured over a period of 5 minutes.

8.8 Through-seat Leakage after cooling-down

max. permissible leakage: 80 ml/min

determined leakage: Ball valve: 21 ml

Result: passed

8.9 Operability

Increase the test pressure to high pressure, close the shut-off valve (Nr. 15) and open the ball valve against the upcoming pressure.

Holding of the high test pressure and measuring of the outer leakage over a period of 5 minutes.

8.10 External leakage following operational test

max. permissible Leakage: 50 ml/min

determined Leakage: Ball valve: 0 ml

Result: passed

8.11 Optical appearance of the gasket after completion of the Fire-Safe-test

The printing on the gasket was still readable. The gasket was in one piece and didn't stick on the flange.

Mannheim, 19th February, 2008
IS-DDB-MAN/jo


TÜV SÜD Industrie Service GmbH
Abteilung Druckbehälter
Die Sachverständige

Dipl.-Ing. John



Attachments: Installation scheme of the test rig
Data sheet

Dimensions in millimetres

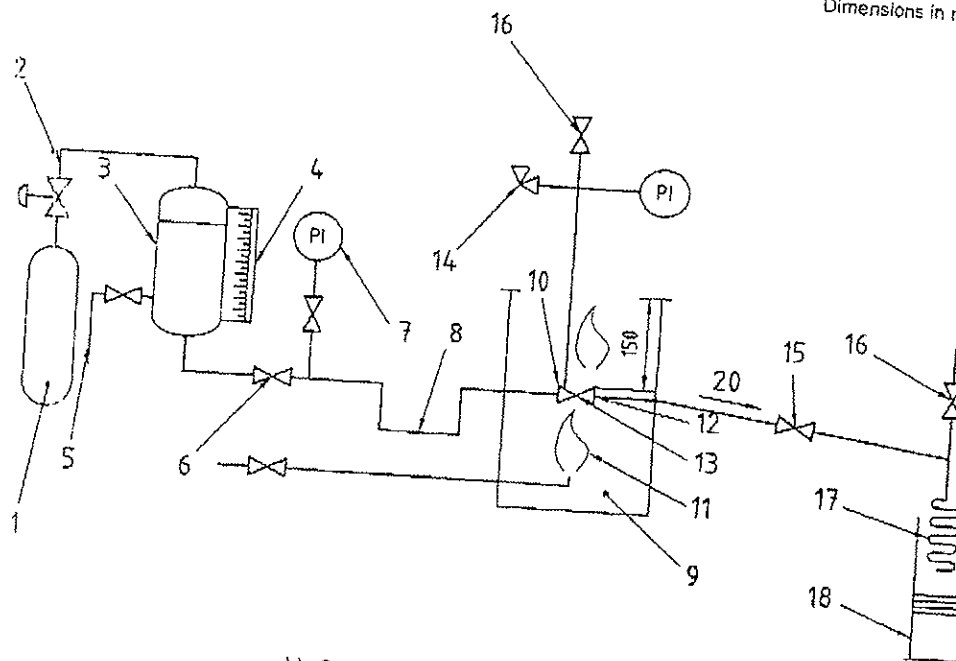

b) Compressed gas as pressure source

- Key
- 1 pressure source
 - 2 pressure regulator and relief
 - 3 vessel for water
 - 4 calibrated sight gauge
 - 5 water supply
 - 6 shut-off valve
 - 7 pressure gauge
 - 8 piping arranged to provide vapour trap (see 5.3.2)
 - 9 enclosure for test
 - 10 test valve mounted horizontally with stem in horizontal position (see 5.6.1)
 - 11 fuel gas supply and burners
 - 12 calorimeter cubes (see 5.3.2)
 - 13 flame environment and body thermocouples (see 5.3.2)
 - 14 pressure gauge and relief valve (see 5.3.2)
 - 15 shut-off valve
 - 16 vent valve
 - 17 condenser
 - 18 container (see 5.3.2)
 - 19 check valve
 - 20 slope
 - 21 clearance: 150 mm

Figure 1 — Recommended systems (continued)




KLINGER®

The global leader in static sealing



Unique Multi-Layer* material concept – A milestone for fibre reinforced gaskets

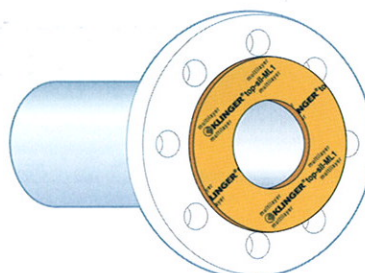

KLINGER® top-sil-ML1
*Revolutionary combination
of synthetic fibres and
different elastomers bound in a
Multi-layer structure.*

**Patent pending*

■ Uses

Multi-Layer sealing material with extended service life and improved flexibility at higher temperatures. Suitable for use with oils, water, steam, gases, salt solutions, fuels, alcohols, moderate organic and inorganic acids, hydrocarbons, lubricants and refrigerants, food industry. Outstanding performance in many applications.

■ Dimensions of the standard sheets

Sizes:

1000 x 1500 mm, 2000 x 1500 mm.

Thicknesses:

0.8 mm, 1.0 mm, 1.5 mm,

2.0 mm, 3.0 mm;

other thicknesses and sizes on request.

Tolerances:

thickness $\pm 10\%$, length ± 50 mm,

width ± 50 mm

■ Surfaces

KLINGERSIL® gasket materials are generally furnished with surfaces of low adhesion. On request, graphite facings and other surface finishes on one or both sides are also available.

■ Function and durability

The performance and service life of KLINGER gaskets depend in large measure on proper storage and fitting, factors beyond the manufacturer's control. We can, however, vouch for the excellent quality of our products.

With this in mind, please also observe our installation instructions.

■ Tests and approvals

BAM, DIN-DVGW,

KTW, WRC and TA-Luft (Clean air) approvals in preparation.

Typical values

Compressibility ASTM F 36 J		%	9
Recovery ASTM F 36 J	min	%	> 50
Stress relaxation DIN 52913	50 MPa, 16h/ 175°C	MPa	34
	50 MPa, 16h/ 300°C	MPa	28
Stress relaxation BS 7531	40 MPa, 16h/ 300°C	MPa	—
Klinger cold/hot compression 50 MPa	thickness decrease at 23°C	%	8
	thickness decrease at 300°C	%	15
Tightness according DIN 3535/6		mg/s x m	< 0.1
Tightness class L	DIN 28090-1		0.1
Specific leakrate λ	VDI 2440	mbar x l/s x m	—
Cold compression	DIN 28091-2	%	6 - 9
Cold recovery	DIN 28091-2	%	3 - 5
Hot compression	DIN 28091-2	%	< 15
Hot recovery	DIN 28091-2	%	1.3
Spring back R	DIN 28091-2	mm	0.026
Thickness increase after fluid immersion ASTM F 146	oil JRM 903: 5 h/150°C	%	4
	fuel B: 5 h/23°C	%	8
Density		g/cm ³	1.7
KLINGER® top-sil-ML1 meets the requirements of BS 7531: Grade X			



Powerful sealing calculation
with online help on
CD-ROM

**Certified according to
DIN EN ISO 9001:2000**

Subject to technical alterations.
Issue: January 2004

Rich. Klinger Dichtungstechnik
GmbH & Co KG
Am Kanal 8-10
A-2352 Gumpoldskirchen, Austria
Tel ++43 (0) 2252/62599-137
Fax ++43 (0) 2252/62599-296
e-mail: mueller@klinger.co.at
<http://www.klinger.co.at>